

RESOLUTION NO. 195

CITY OF DOVER, IDAHO

A RESOLUTION OF THE MAYOR AND COUNCIL OF THE CITY OF DOVER, COUNTY OF BONNER, A MUNICIPAL CORPORATION OF IDAHO, SETTING STANDARDS FOR WATER SERVICE CONNECTIONS AND PROVIDING FOR AN EFFECTIVE DATE, RESCINDING RESOLUTION NO. 176. – WATER STANDARDS.

WHEREAS, the Mayor and City Council have determined that it is necessary to establish standards for installation, maintenance, repair, and reporting of a user’s water connection in order to safely and efficiently provide water services; and

WHEREAS, Dover City Code Title 8, Chapter 1 provides that the city may set standards and these standards shall be adopted by resolution.

NOW THEREFORE, BE IT RESOLVED BY THE MAYOR AND CITY COUNCIL OF THE CITY OF DOVER, BONNER COUNTY, IDAHO THAT:

SECTION 1: WATER SERVICE CONNECTION STANDARDS

The City hereby adopts the City of Dover Water Standards set forth in Exhibit A attached.

SECTION 2: EFFECTIVE DATE

This Resolution shall be in full force and effect after its passage and approval.

PASSED BY ROLL CALL VOTE OF THE City Council and APPROVED by the Mayor this 12th day of October, 2023.


Councilor Bledsoe	<u>Aye</u>
Councilor Glass	<u>Aye</u>
Councilor Hoffman	<u>Aye</u>
Councilor Parkin	<u>Aye.</u>

SIGNED BY THE MAYOR this 12th day of October, 2023


George E. Eskridge


Attest:


Michele C. Hutchings, Clerk

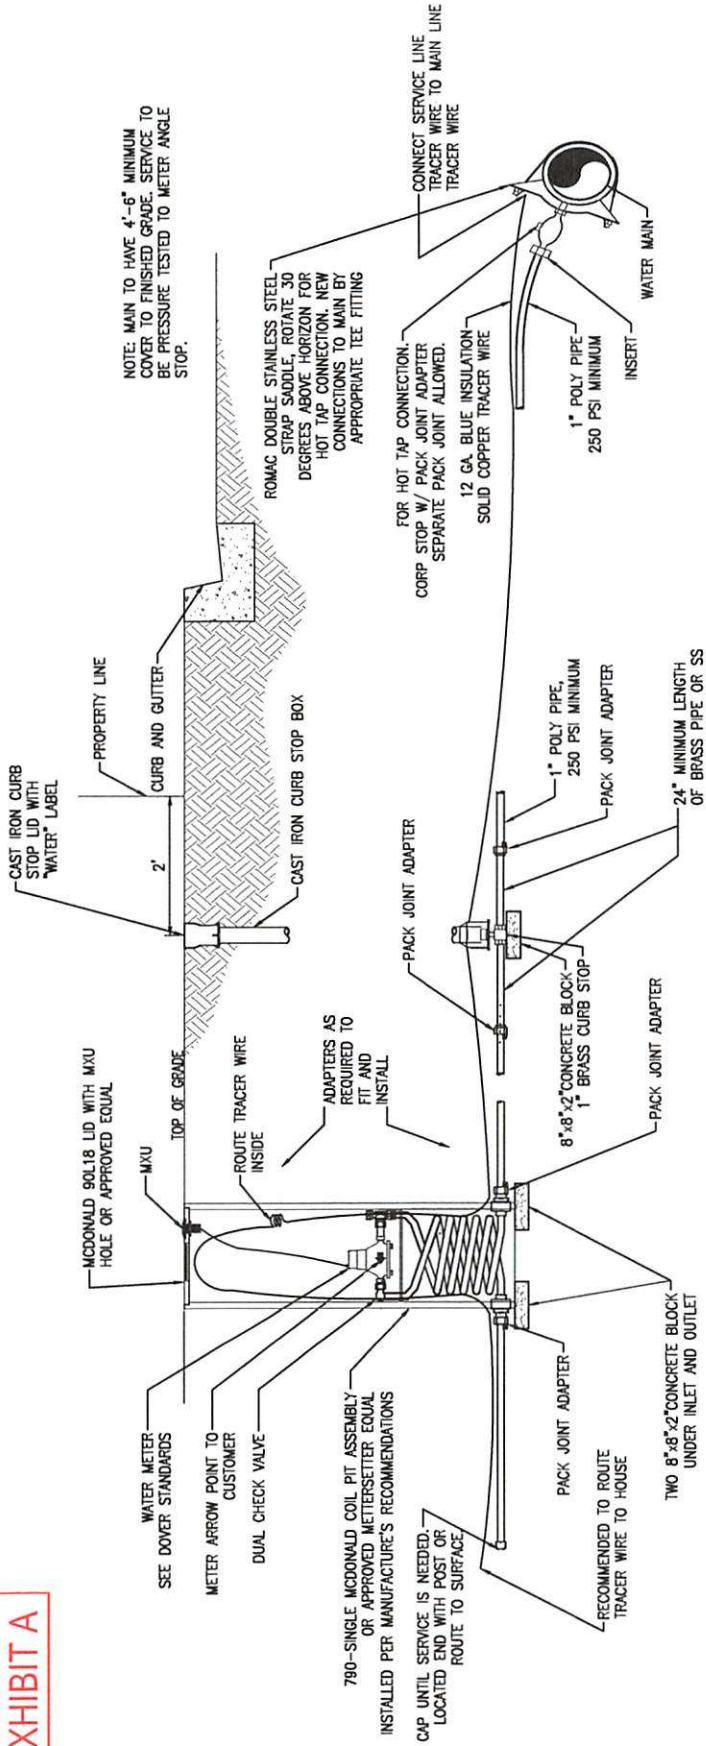

NOTE: MAIN TO HAVE 4"-6" MINIMUM COVER TO FINISHED GRADE. SERVICE TO BE PRESSURE TESTED TO METER ANGLE STOP.

METER SET OUTSIDE OF DRIVE WAYS (TYPICAL)

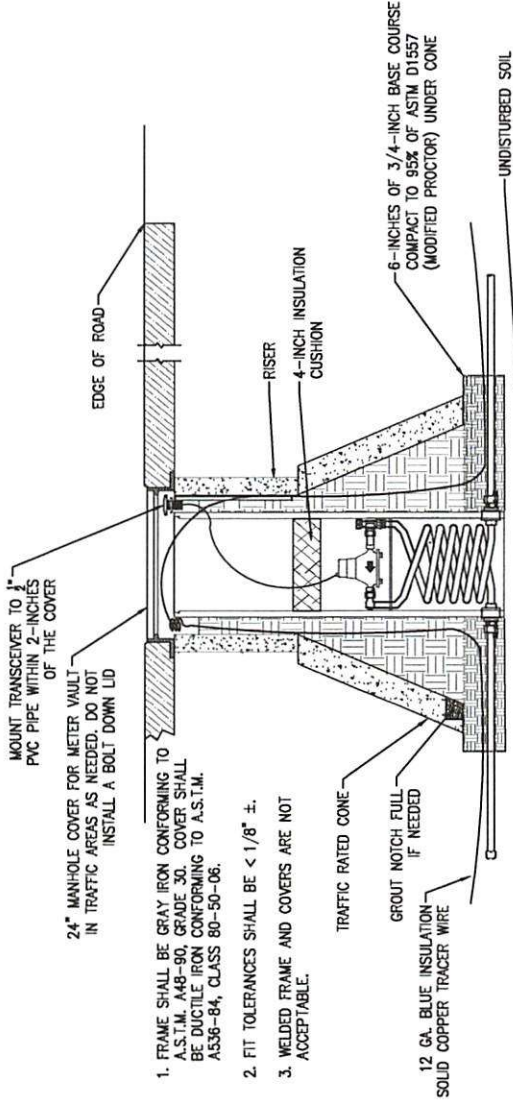

1. FRAME SHALL BE GRAY IRON CONFORMING TO A.S.T.M. A48-90, GRADE 30. COVER SHALL BE DUCTILE IRON CONFORMING TO A.S.T.M. A536-84, CLASS 80-50-06.
2. FIT TOLERANCES SHALL BE $< 1/8" \pm$.
3. WELDED FRAME AND COVERS ARE NOT ACCEPTABLE.

METER SET IN PRIVATE DRIVE WAYS (TYPICAL)

UP TO 10,000 POUNDS. HEAVIER LOADS REQUIRE CUSTOM DESIGN.

NOT TO SCALE



NO.	REVISION	DATE