


NO.	DESCRIPTION	BY	DATE

WATER CONNECTION STANDARDS
 CITY OF DOVER IDAHO
 STANDARD WATER METER PIT SET, AND
 MAIN LINE CONNECTION
 STANDARDS

FILE	WATER METER SET DOVER
JUB PROJ #	20-16-005
DRAWN BY	JUB
DESIGN BY	JUB
CHECKED BY	BMC


LAST UPDATED: 11/5/2019
 SHEET NUMBER:

W-1

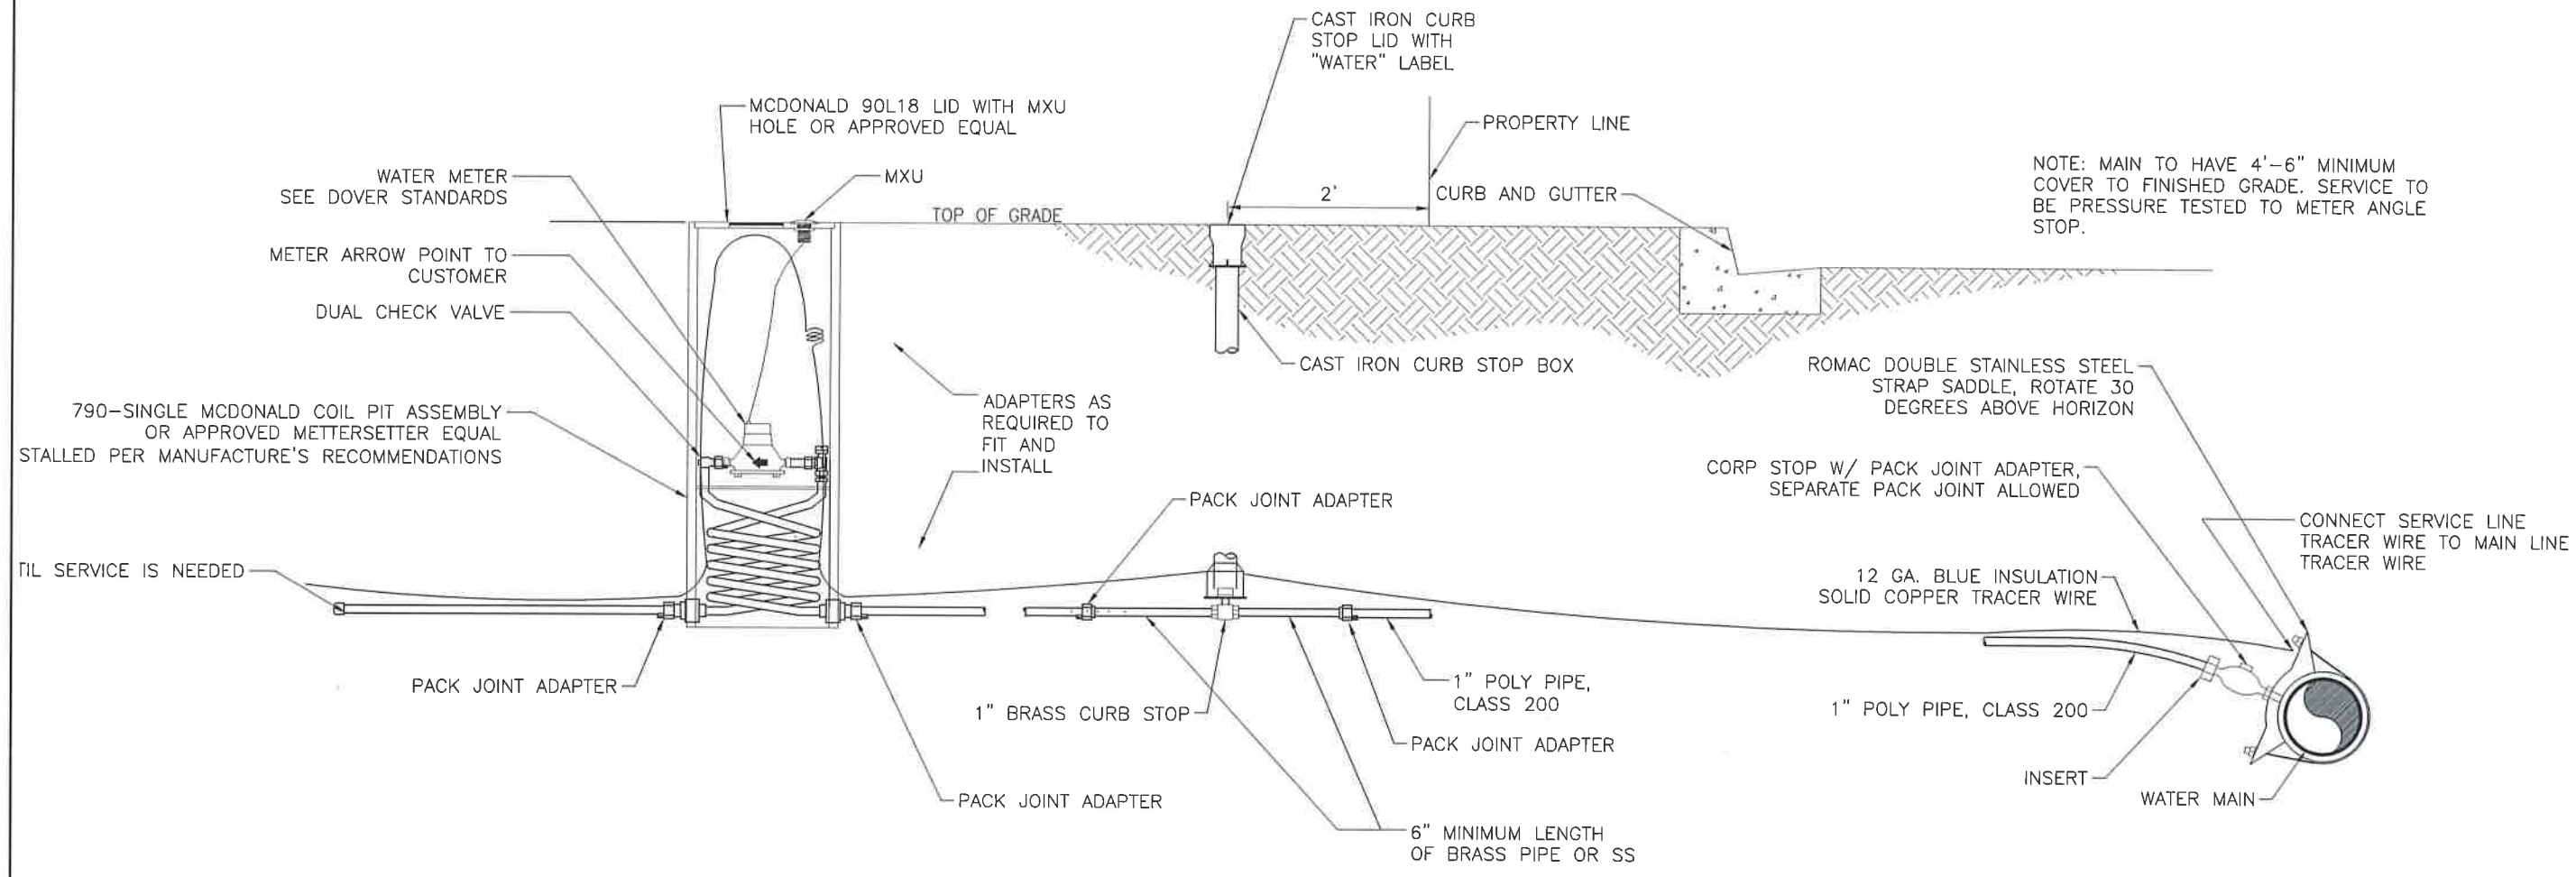

NOTE: MAIN TO HAVE 4'-6" MINIMUM COVER TO FINISHED GRADE. SERVICE TO BE PRESSURE TESTED TO METER ANGLE STOP.

METER SET OUTSIDE OF DRIVE WAYS (TYPICAL)

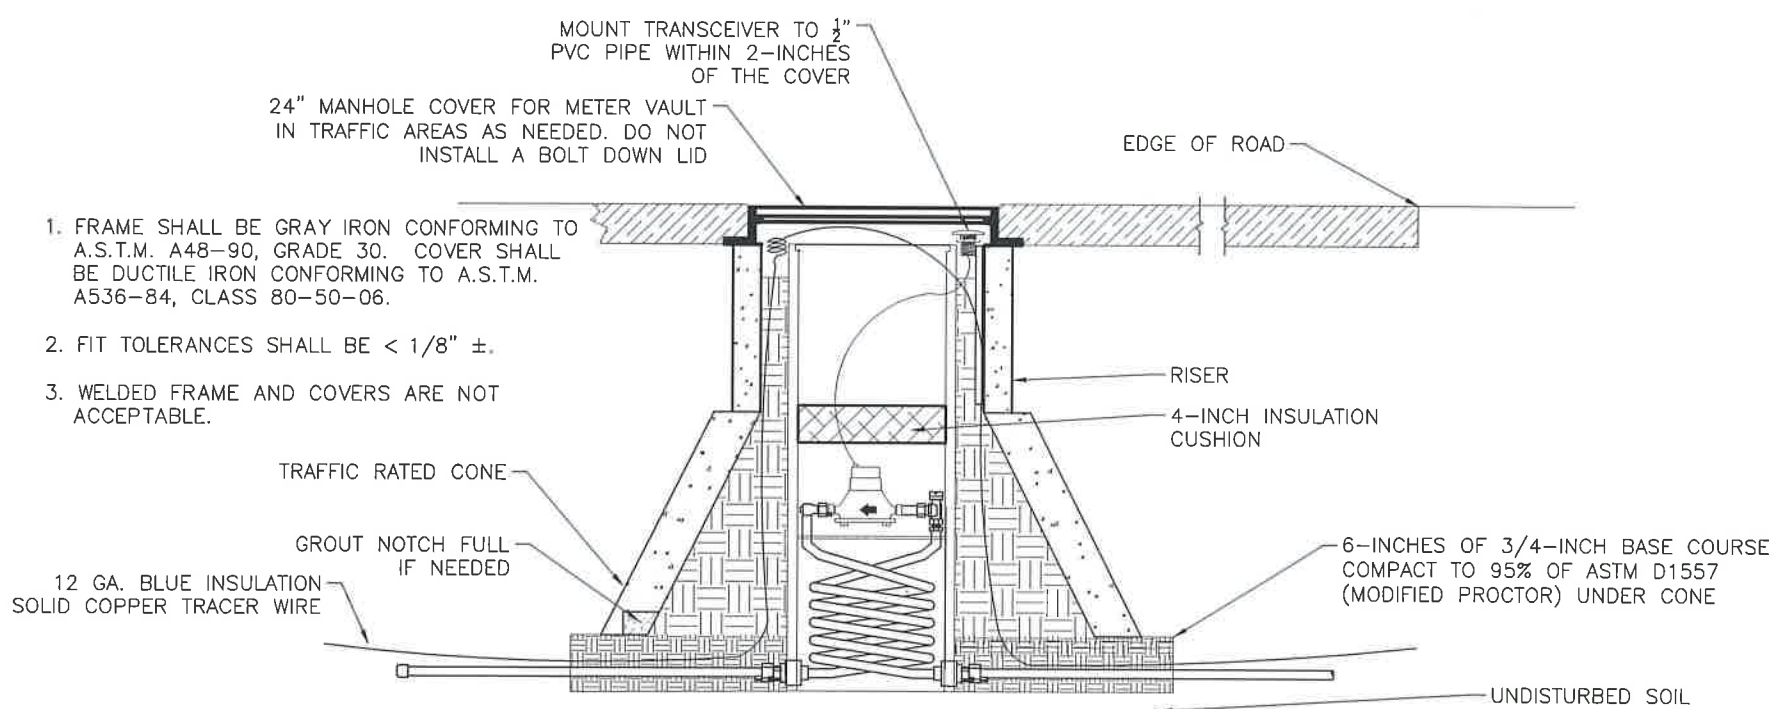

1. FRAME SHALL BE GRAY IRON CONFORMING TO A.S.T.M. A48-90, GRADE 30. COVER SHALL BE DUCTILE IRON CONFORMING TO A.S.T.M. A536-84, CLASS 80-50-06.
2. FIT TOLERANCES SHALL BE $< 1/8" \pm$.
3. WELDED FRAME AND COVERS ARE NOT ACCEPTABLE.

METER SET IN PRIVATE DRIVE WAYS (TYPICAL)

UP TO 10,000 POUNDS. HEAVIER LOADS REQUIRE CUSTOM DESIGN.

NOT TO SCALE



Plot Date: 11/7/2019 2:27 PM Plotted By: Brett M. Converse
 Data Created: 5/1/2019 C:\JUB\SS\CONVERSE\DOCUMENTS\DOVER\WATER STANDARDS\CITY OF DOVER\METER SET DOVER COIL SET ONLY.DWG